



An diesen Drahnten fehlt die Verbindungsbezeichnung.

3501
3502
3503
3504
3505
3506
3507
3508
3509
3510
3511
3512
3513
3514
3515
3516
3517
3518
3519
3520
3521
3522
3523
3524
3525
3526
3527
3528
3529
3530

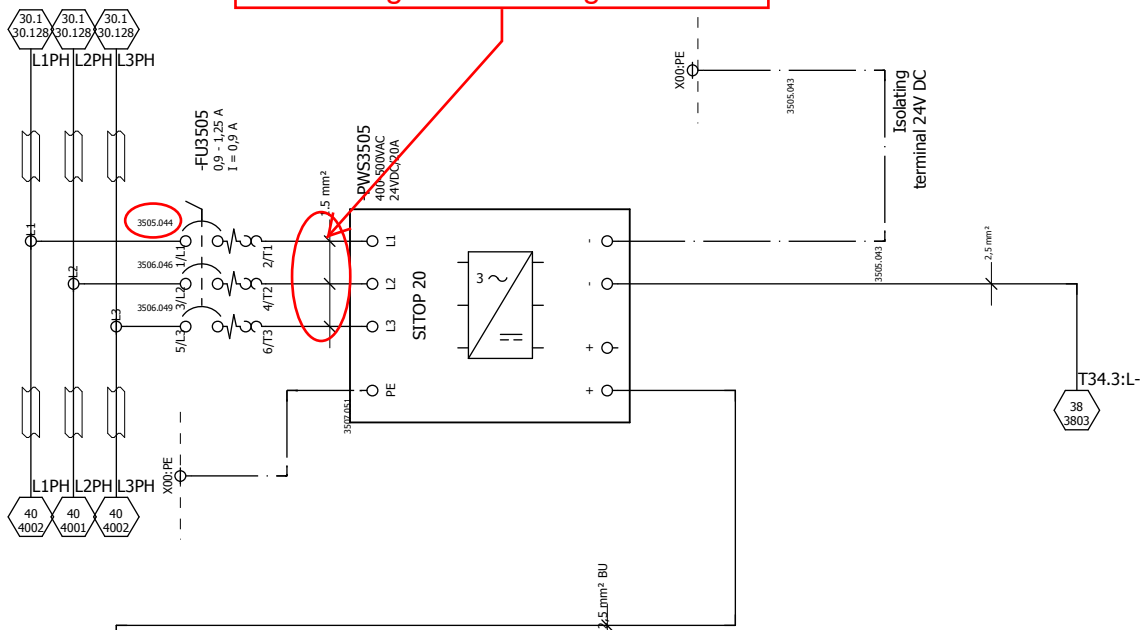

Power supply unit 24V DC

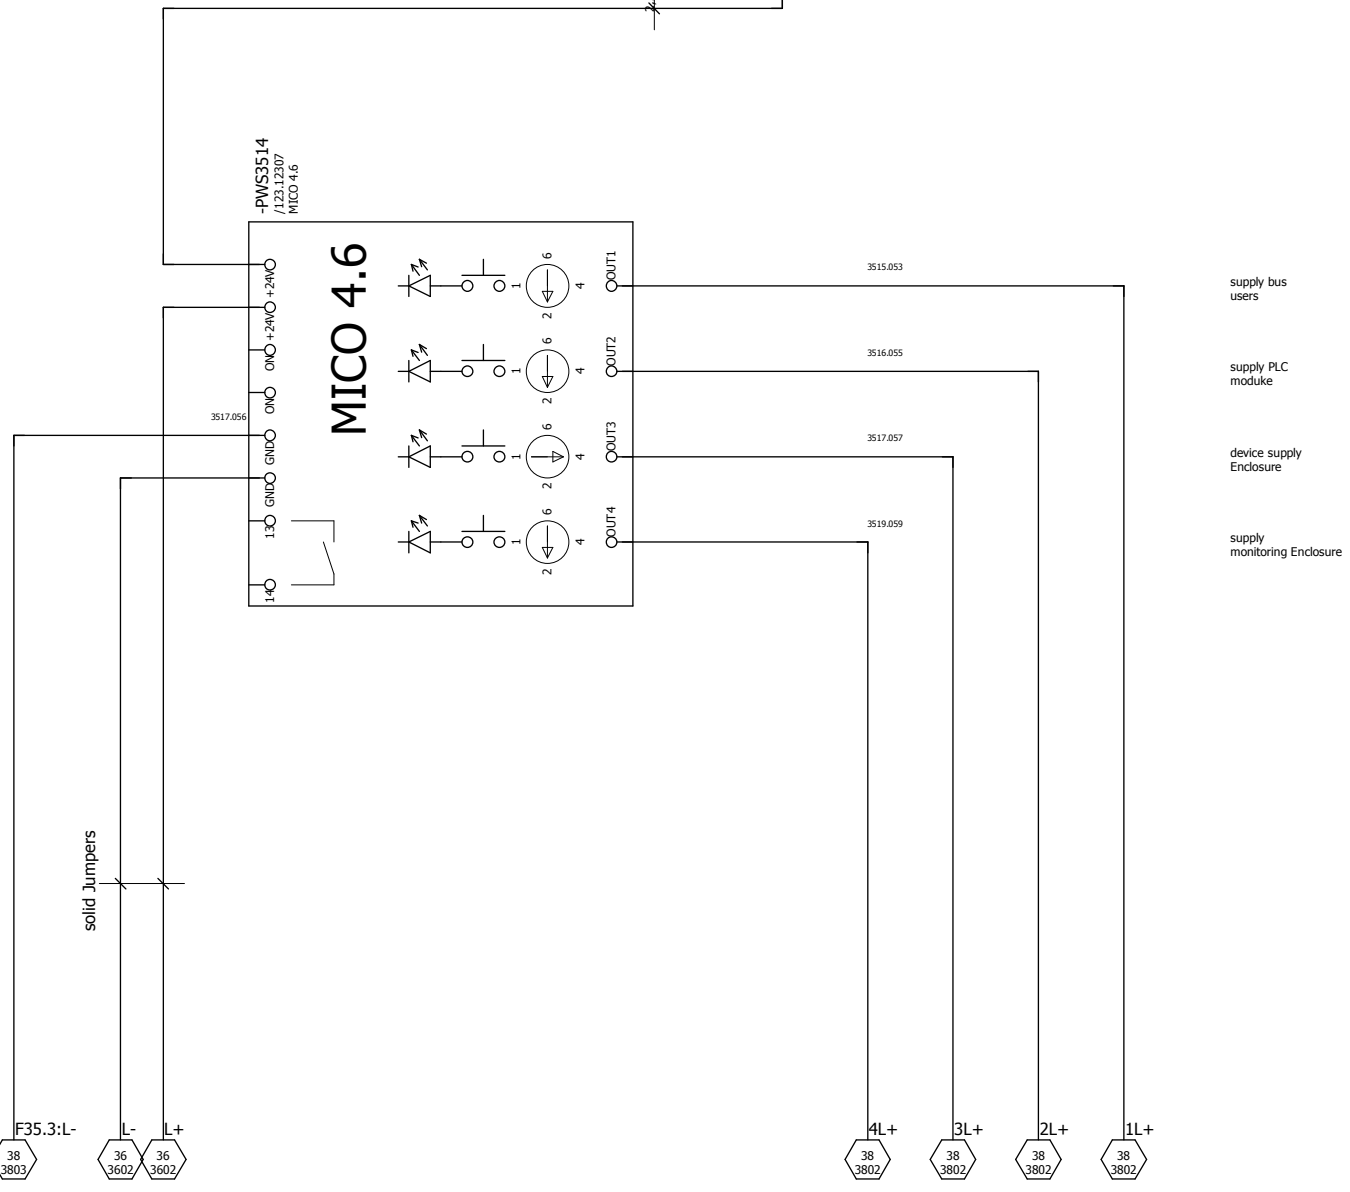

supply bus users
supply PLC module
device supply Enclosure
supply monitoring Enclosure