


CUSTOMER
INPUT POWER

L1 L2 L3 GND

9000 9001 9002 9003 9004 9005 9006 9007 9008 9009 9010 9011 9012 9013 9014 9015 9016 9017 9018 9019 9020 9021 9022 9023 9024 9025 9026 9027 9028 9029 9030 9031 9032 9033 9034 9035 9036 9037 9038 9039

9040 9041 9042 9043 9044 9045 9046 9047 9048 9049 9050 9051 9052 9053 9054 9055 9056 9057 9058 9059 9060 9061 9062 9063 9064 9065 9066 9067 9068 9069 9070 9071 9072 9073 9074 9075 9076 9077 9078 9079

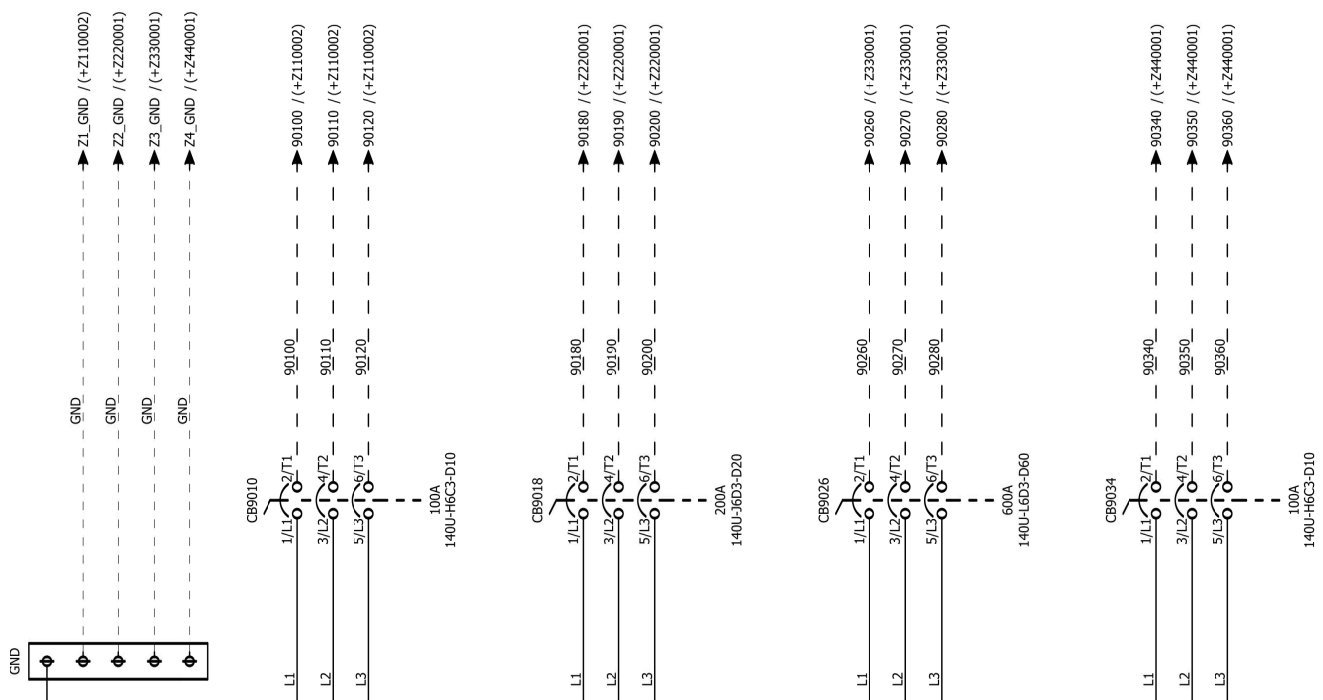

Z1
480 VAC
POWER SUPPLY




Z2
480 VAC
POWER SUPPLY

Z3
480 VAC
POWER SUPPLY

Z4
480 VAC
POWER SUPPLY

NOTE: POWER DISTRIBUTION PROVIDED BY OTHERS.
NOT WITHIN FACTORY AUTOMATION SYSTEMS SCOPE OF SUPPLY.




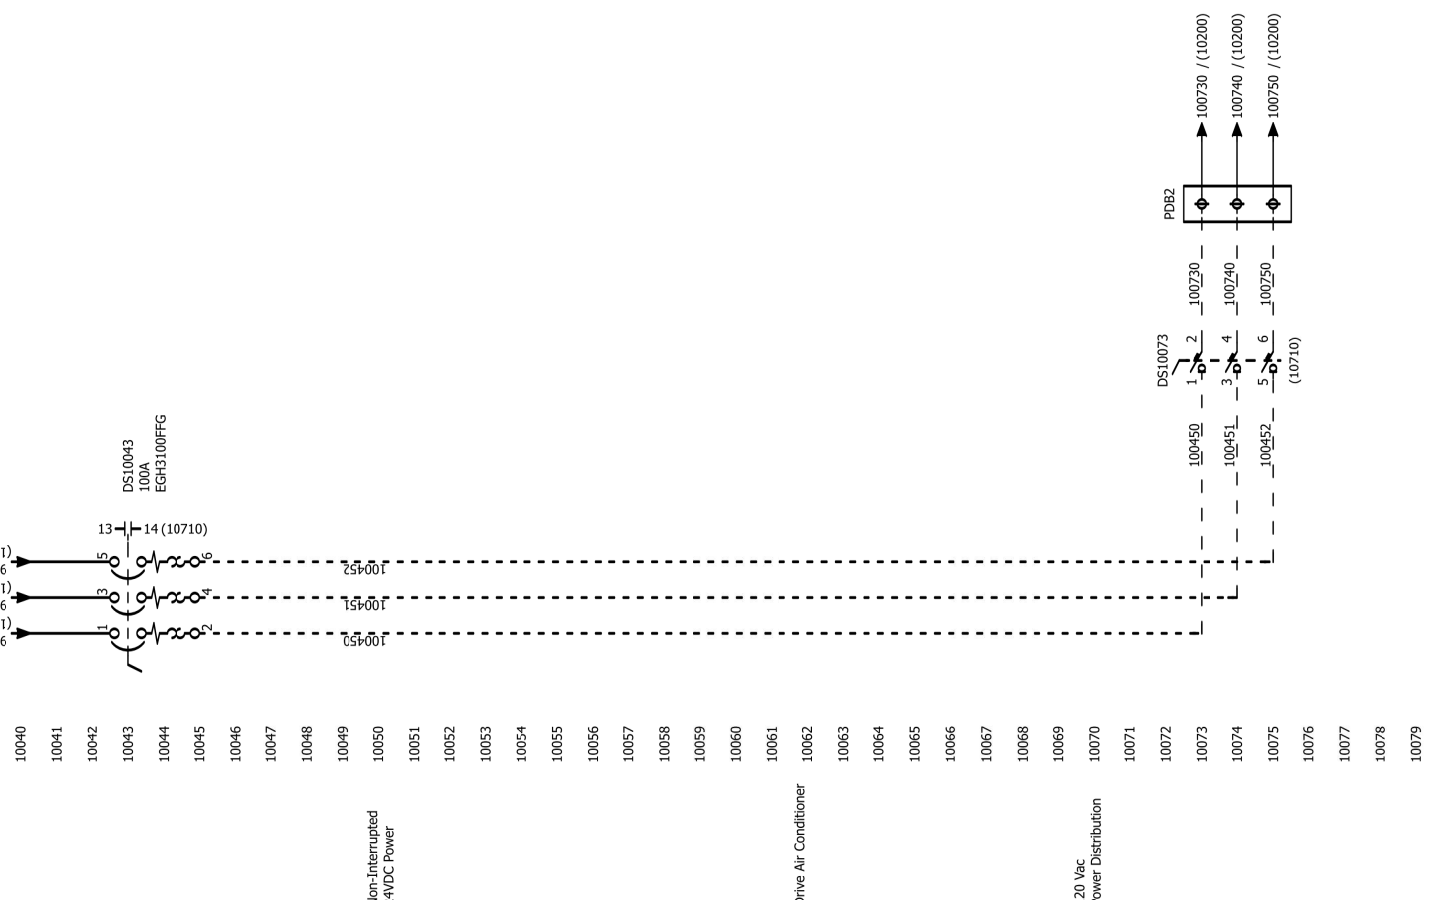
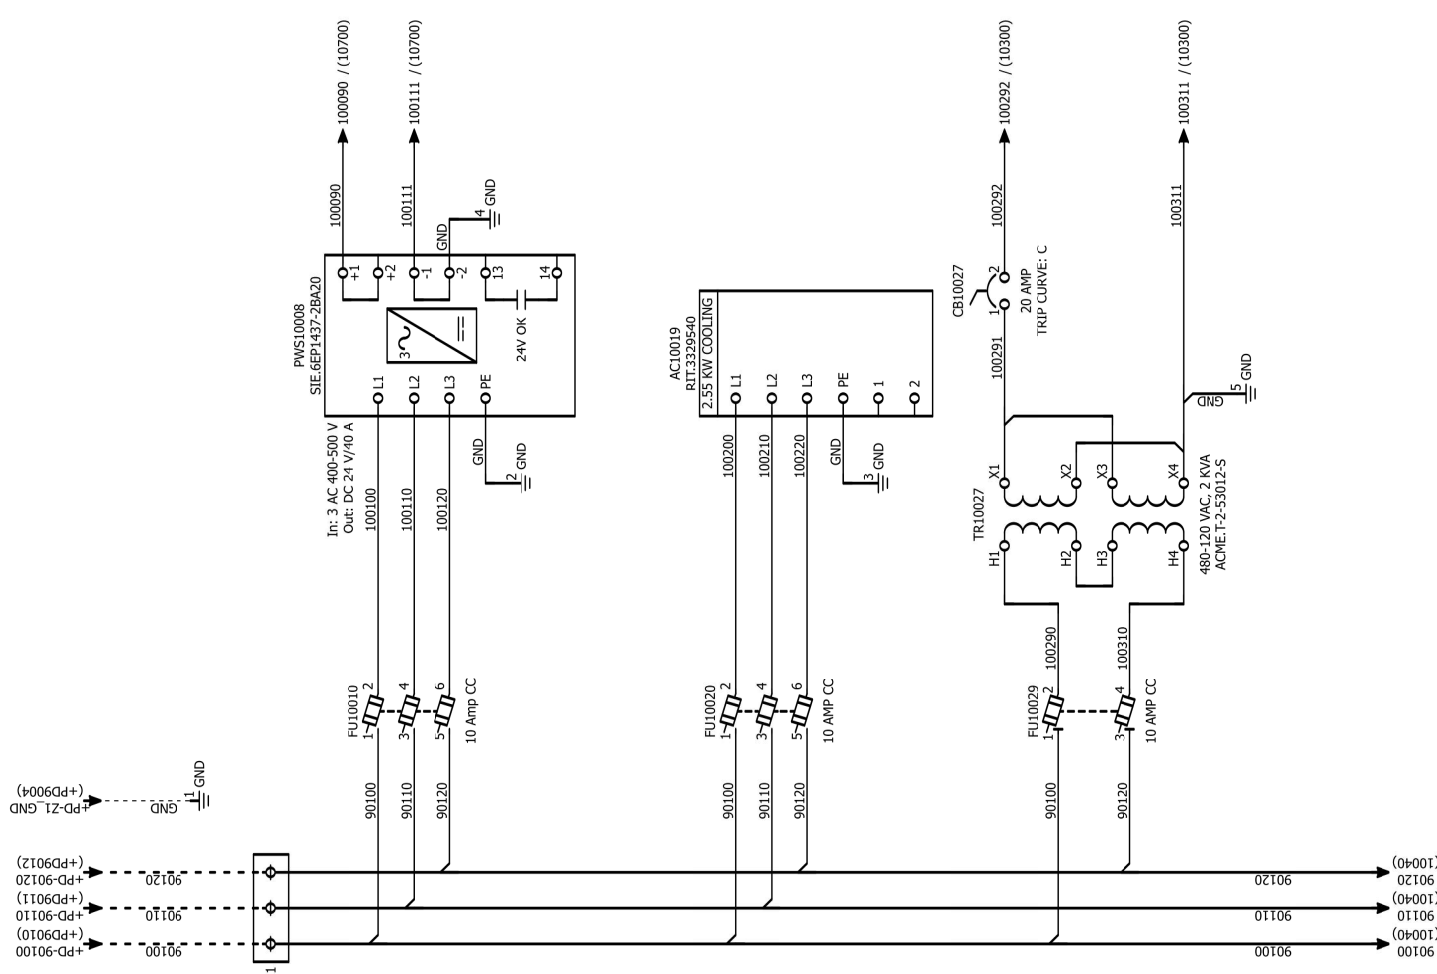



- 10040
- 10041
- 10042
- 10043
- 10044
- 10045
- 10046
- 10047
- 10048
- 10049
- 10050
- 10051
- 10052
- 10053
- 10054
- 10055
- 10056
- 10057
- 10058
- 10059
- 10060
- 10061
- 10062
- 10063
- 10064
- 10065
- 10066
- 10067
- 10068
- 10069
- 10070
- 10071
- 10072
- 10073
- 10074
- 10075
- 10076
- 10077
- 10078
- 10079

Non-Interrupted
24VDC Power

Drive Air
Conditioner

120 Vac
Power Distribution

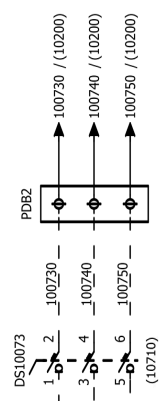




- 10040
- 10041
- 10042
- 10043
- 10044
- 10045
- 10046
- 10047
- 10048
- 10049
- 10050
- 10051
- 10052
- 10053
- 10054
- 10055
- 10056
- 10057
- 10058
- 10059
- 10060
- 10061
- 10062
- 10063
- 10064
- 10065
- 10066
- 10067
- 10068
- 10069
- 10070
- 10071
- 10072
- 10073
- 10074
- 10075
- 10076
- 10077
- 10078
- 10079

Non-Interrupted
24VDC Power










Drive Air
Conditioner

120 Vac
Power Distribution

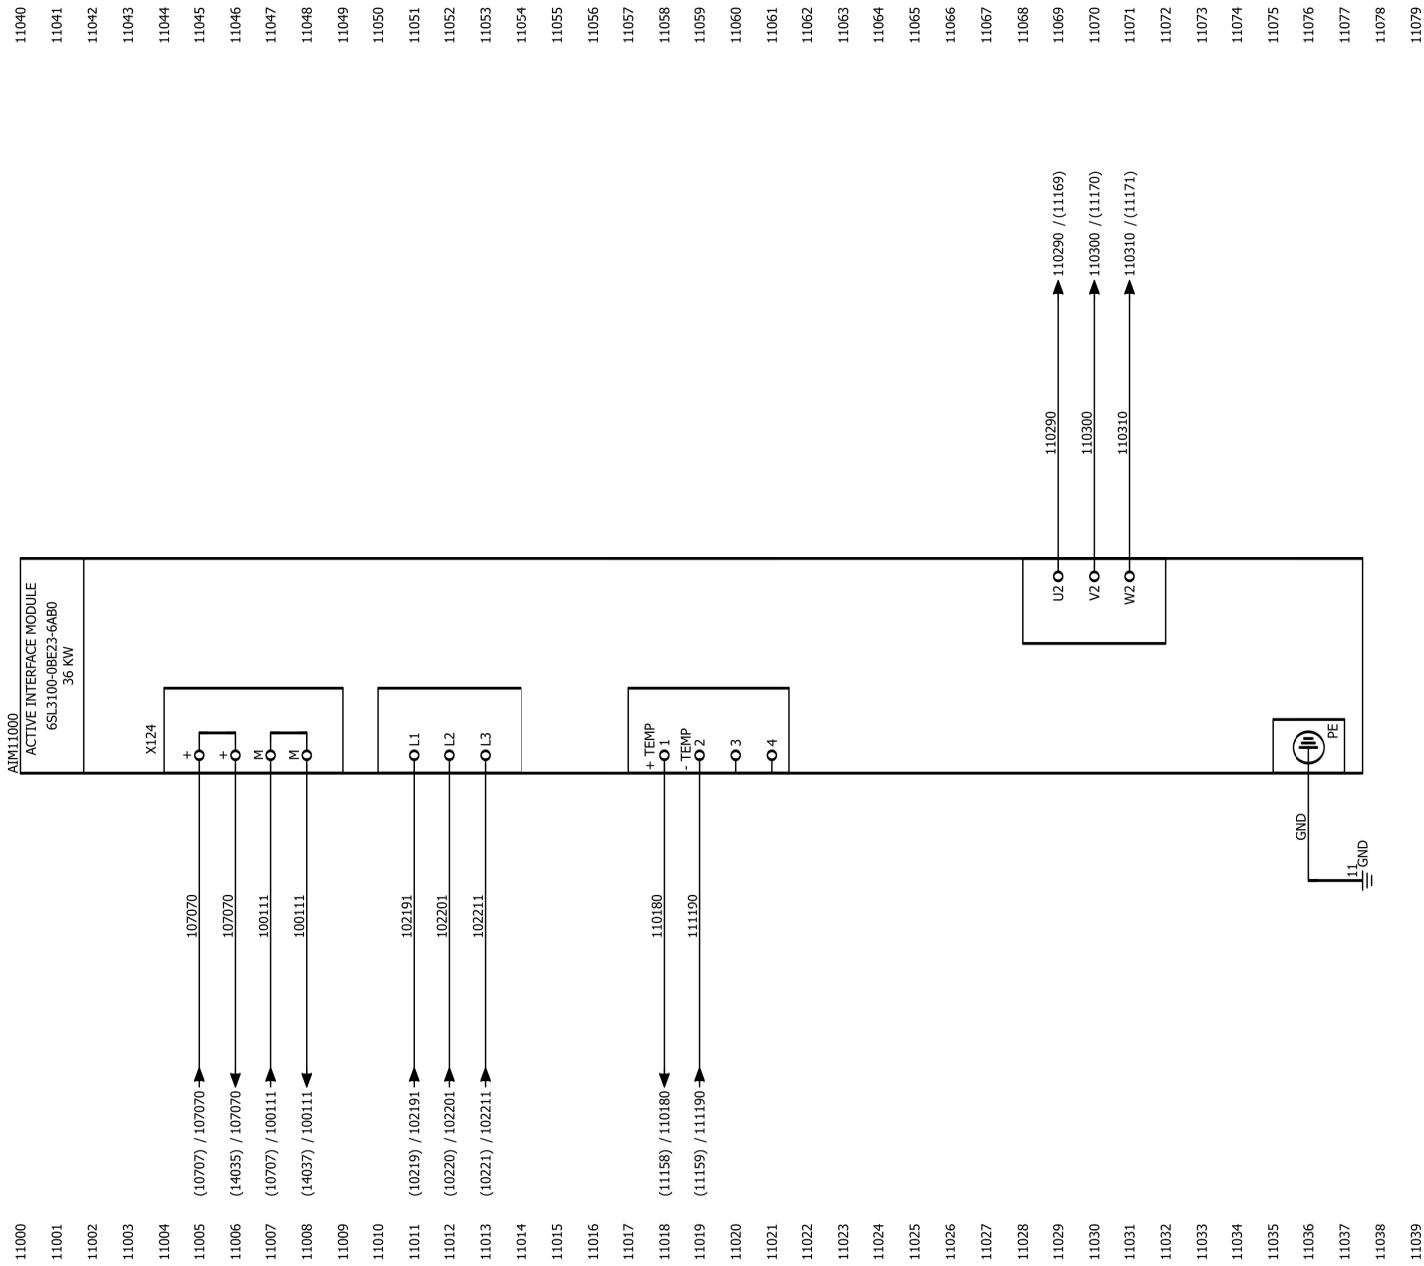

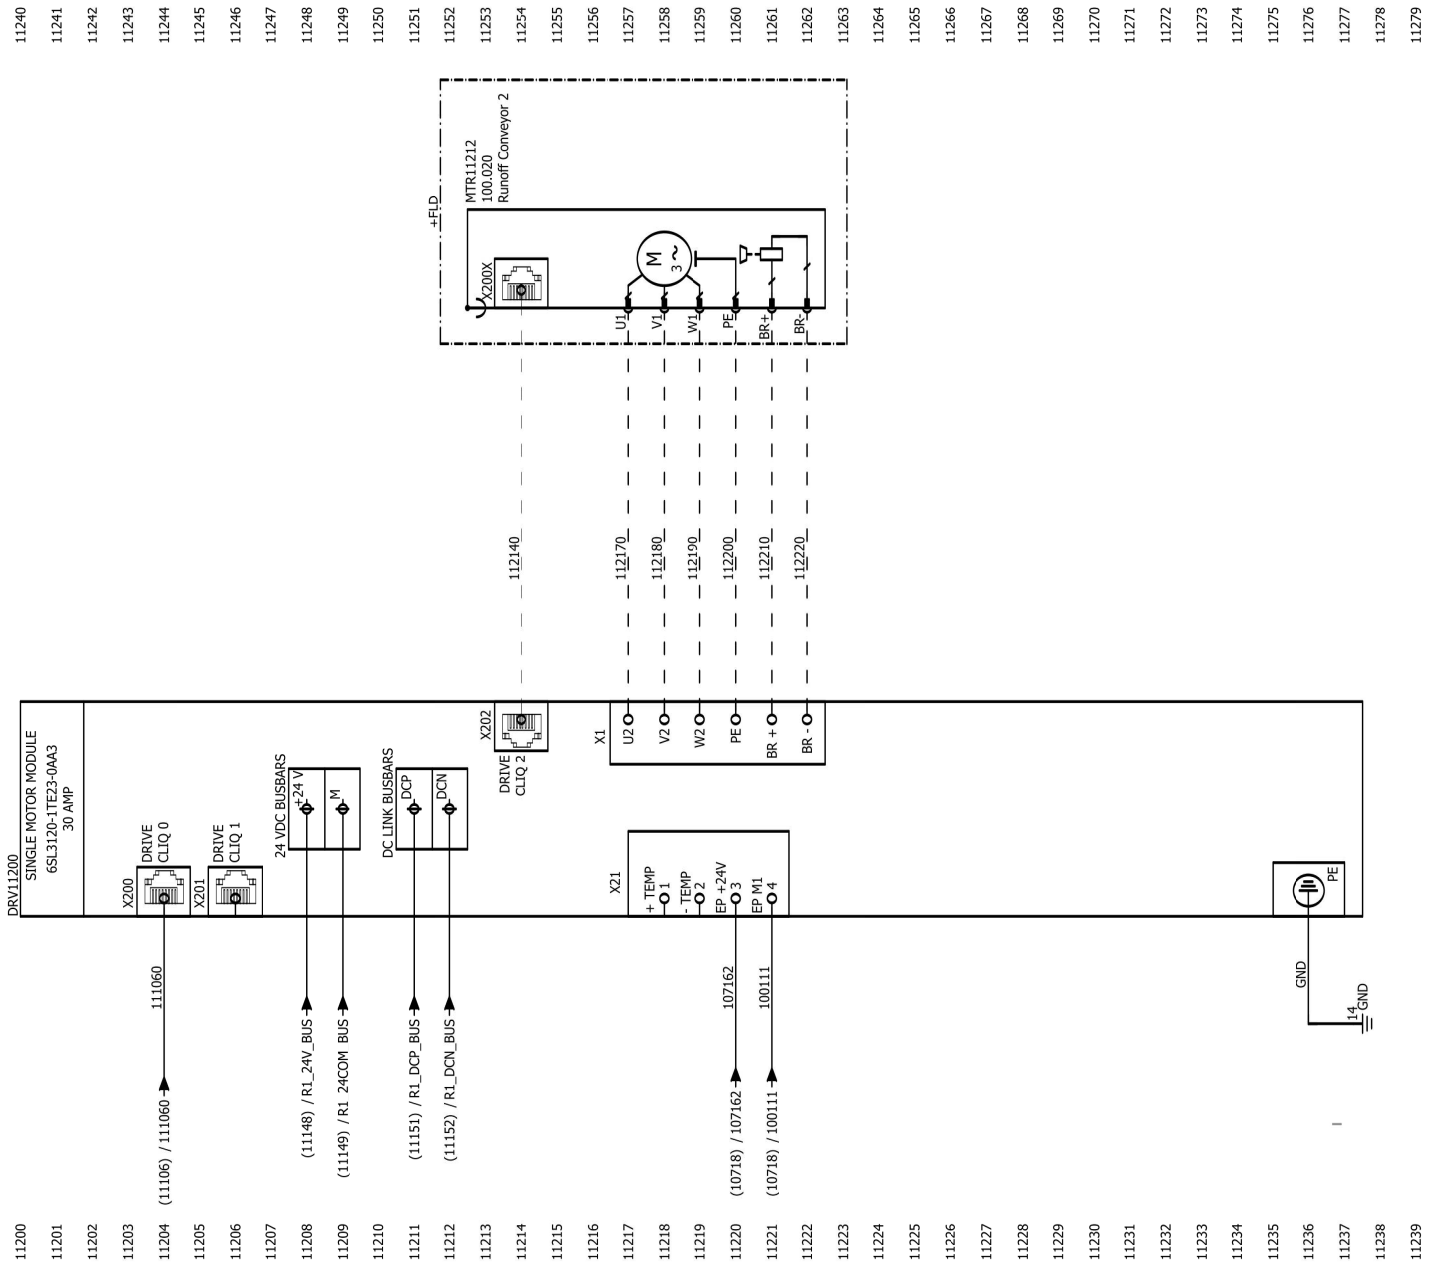

Node: 10 Slot: 0

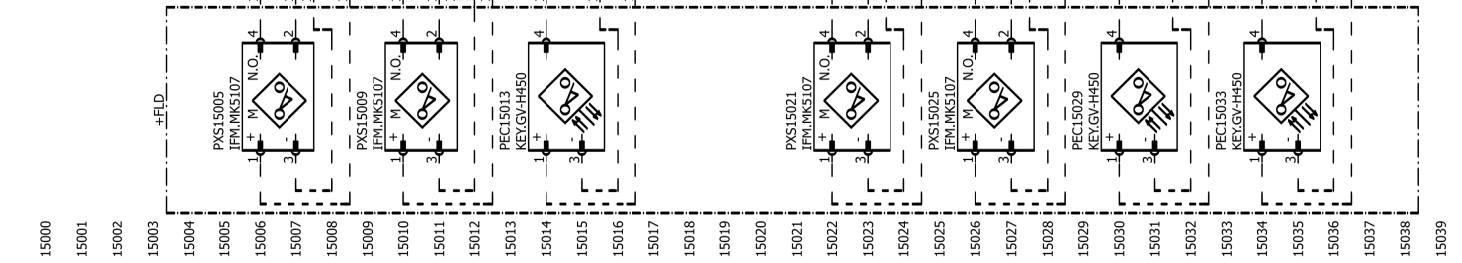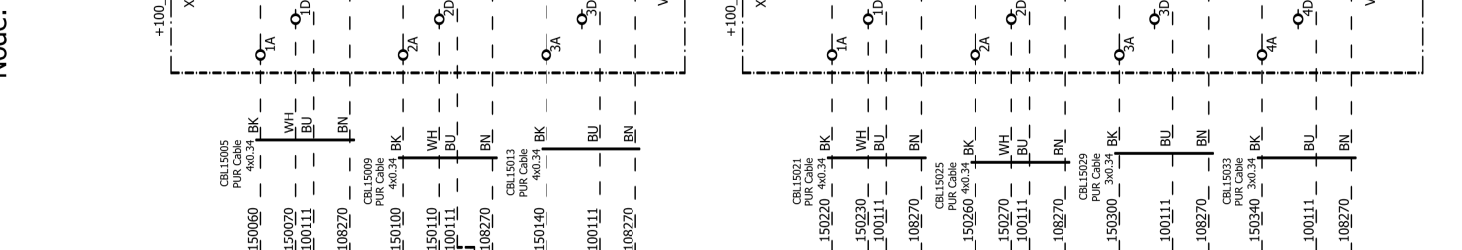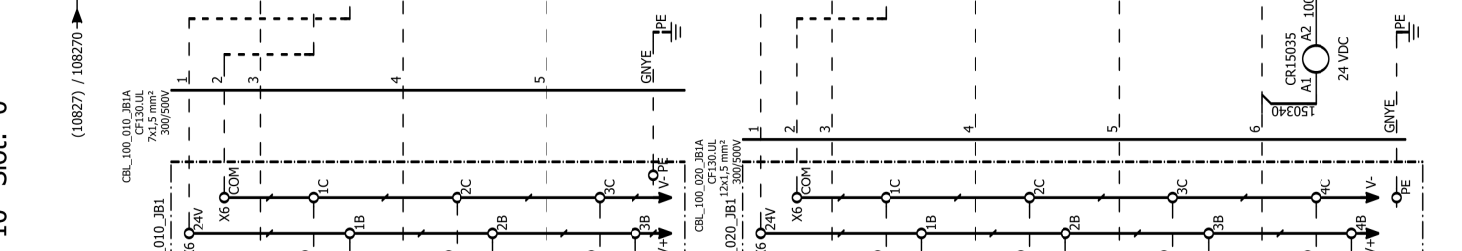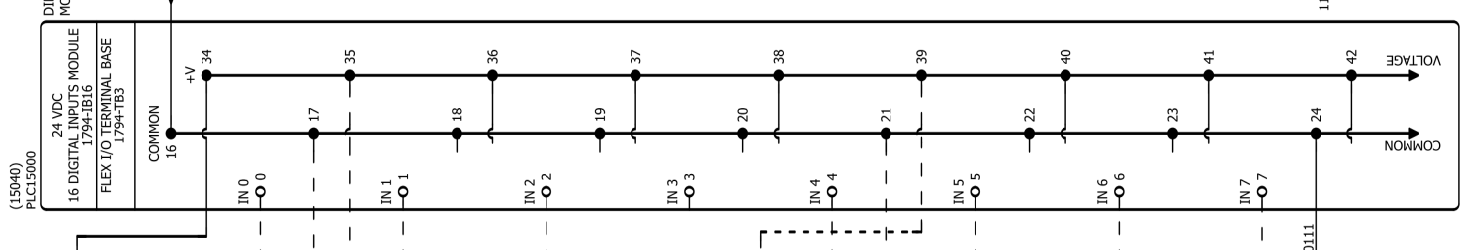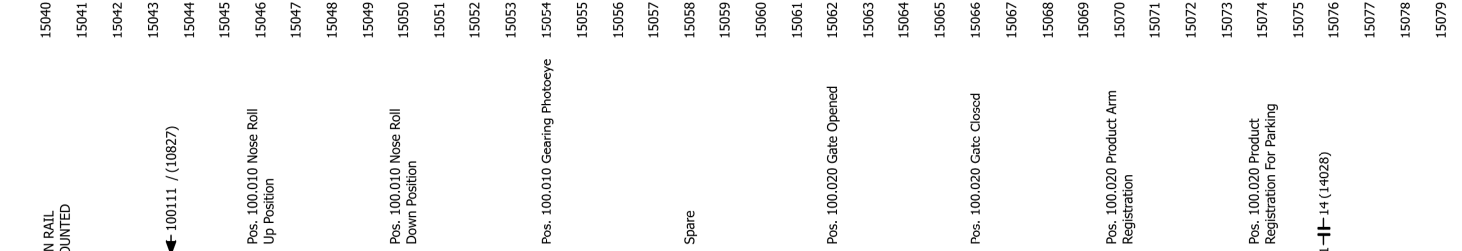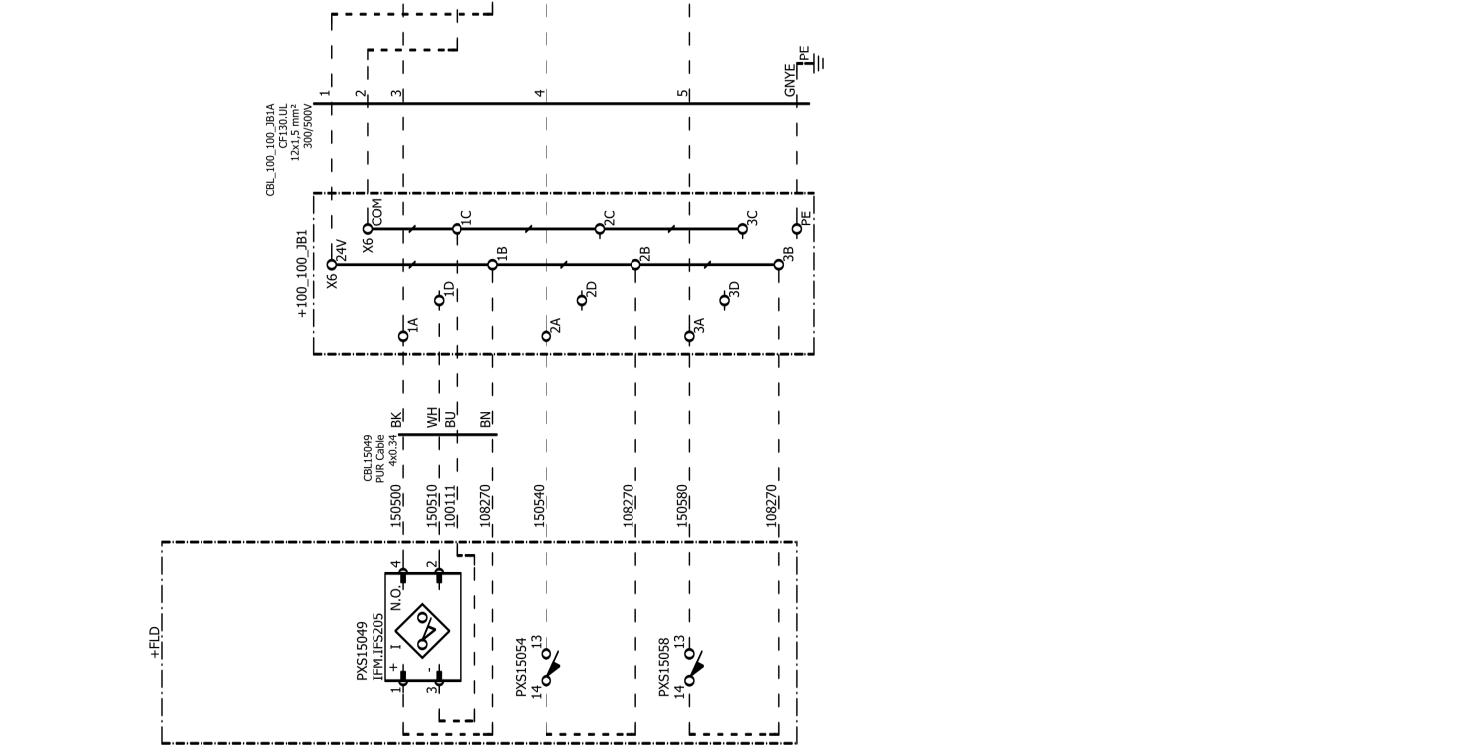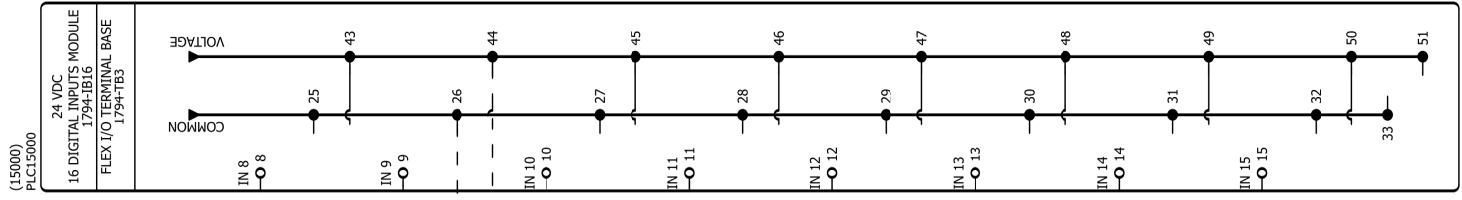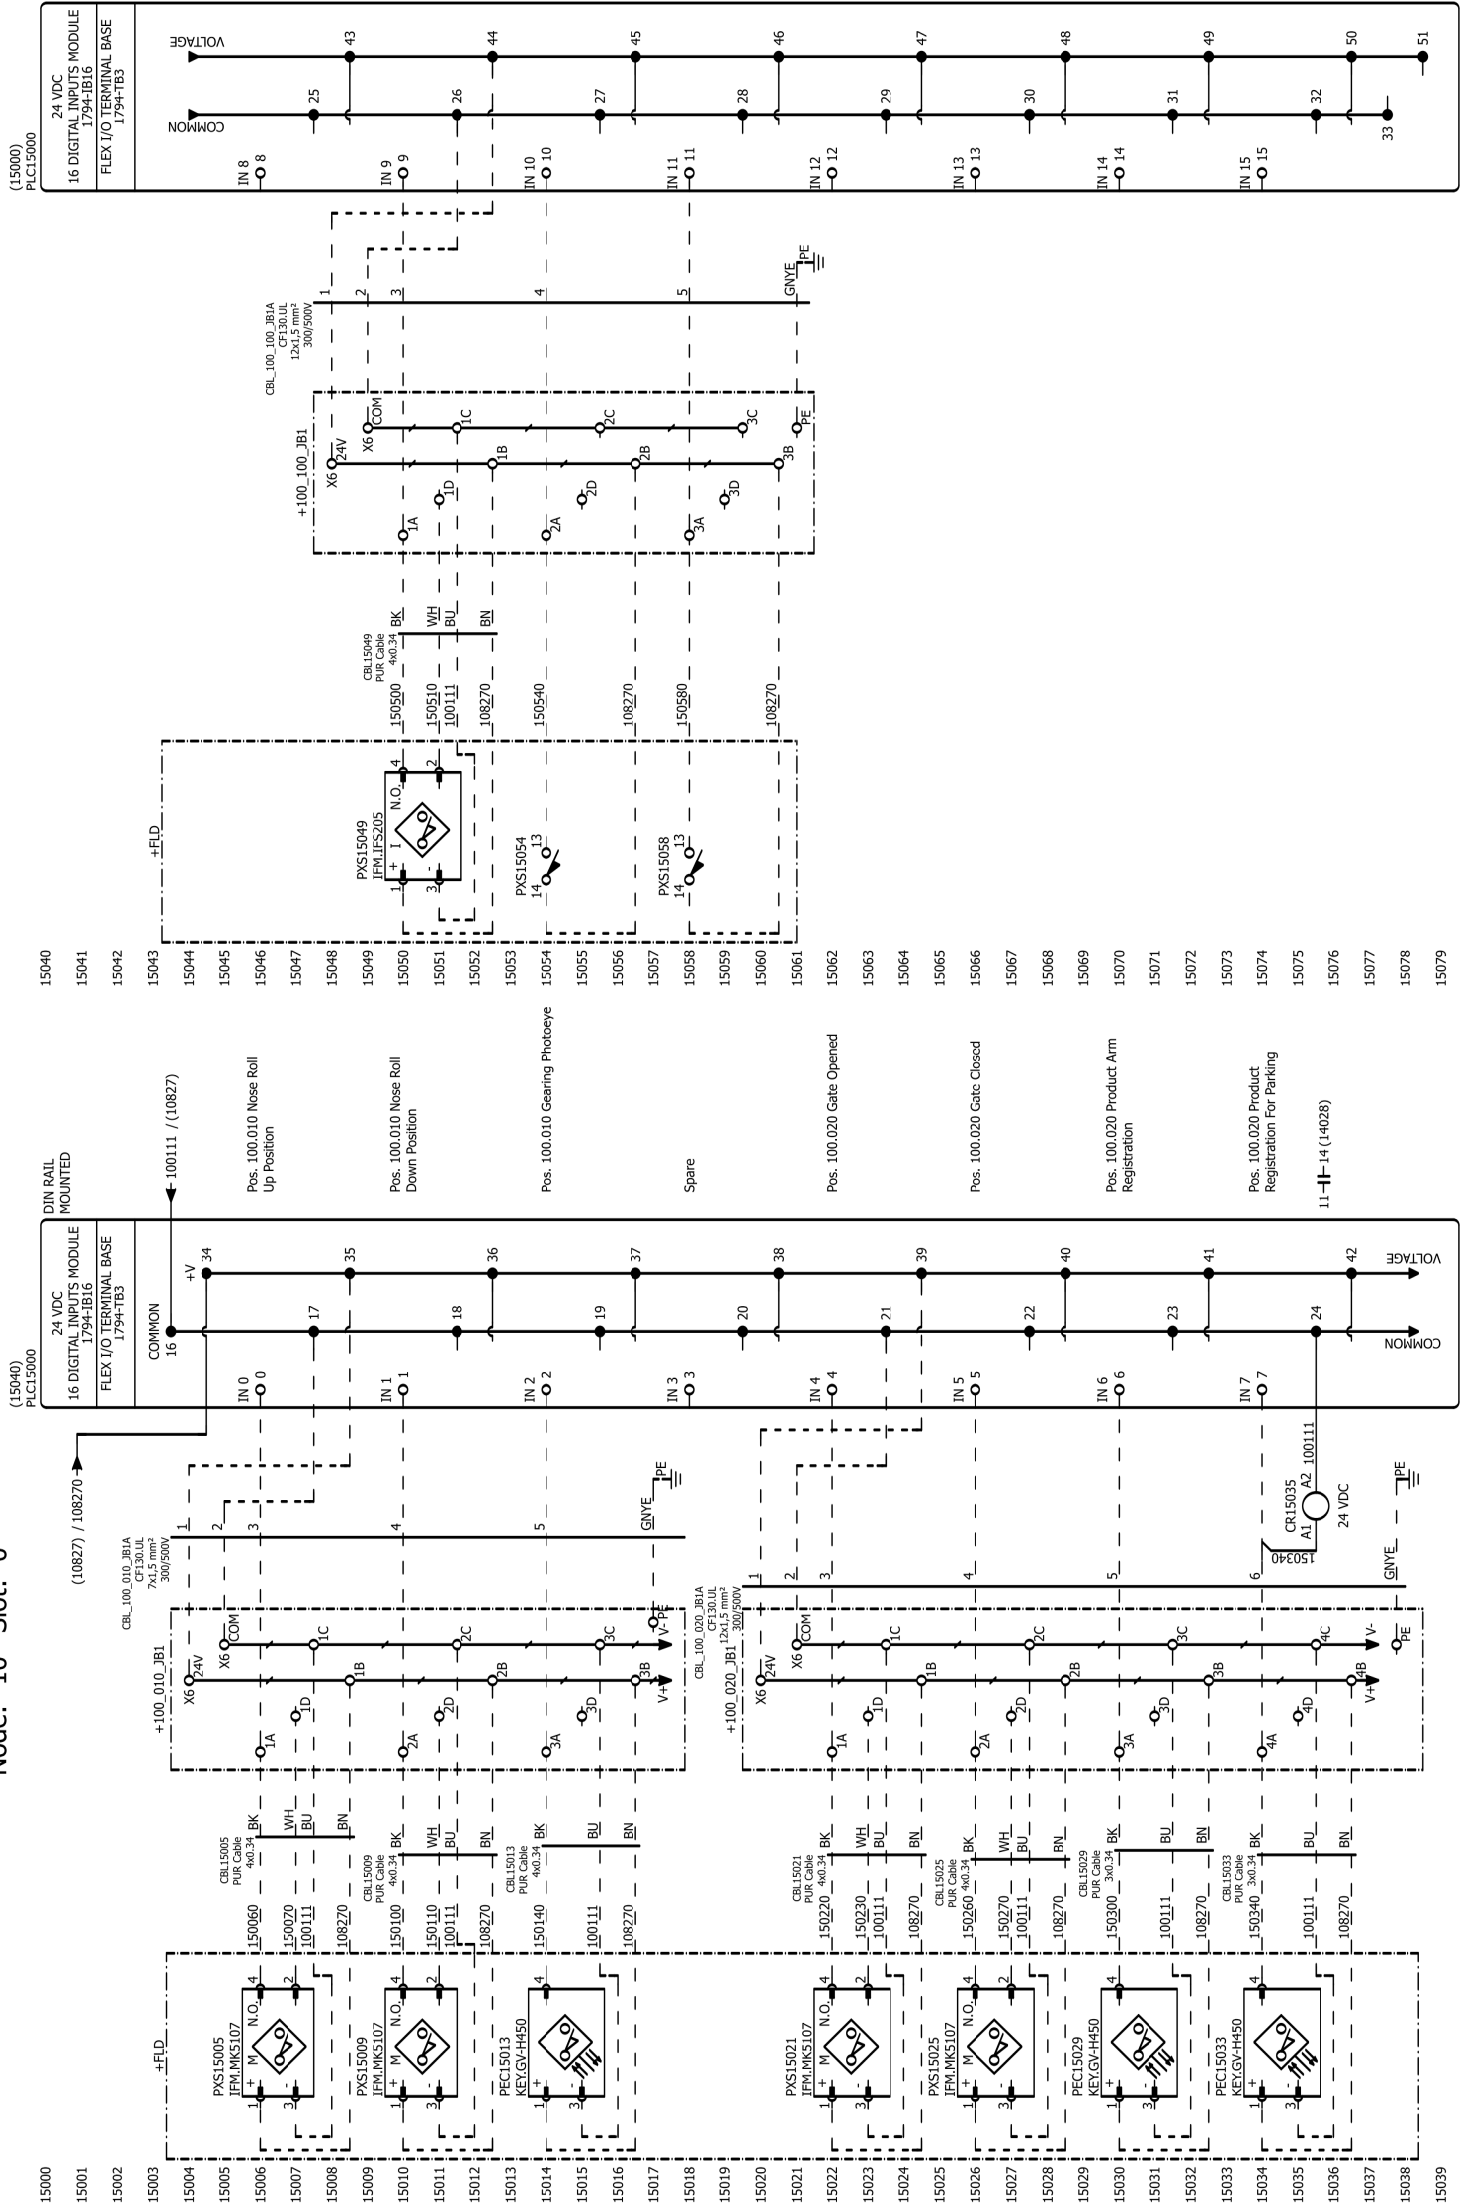

(15000) PLC15000
 24VDC
 16 DIGITAL INPUTS MODULE
 FLEX I/O TERMINAL BASE
 1734TBSJ



15040
 15041
 15042
 15043
 15044
 15045
 15046
 15047
 15048
 15049
 15050
 15051
 15052
 15053
 15054
 15055
 15056
 15057
 15058
 15059
 15060
 15061
 15062
 15063
 15064
 15065
 15066
 15067
 15068
 15069
 15070
 15071
 15072
 15073
 15074
 15075
 15076
 15077
 15078
 15079

(15040) PLC15000
 24VDC
 16 DIGITAL INPUTS MODULE
 FLEX I/O TERMINAL BASE
 1734TBSJ

15000
 15001
 15002
 15003
 15004
 15005
 15006
 15007
 15008
 15009
 15010
 15011
 15012
 15013
 15014
 15015
 15016
 15017
 15018
 15019
 15020
 15021
 15022
 15023
 15024
 15025
 15026
 15027
 15028
 15029
 15030
 15031
 15032
 15033
 15034
 15035
 15036
 15037
 15038
 15039

(15040) PLC15000
 24VDC
 16 DIGITAL INPUTS MODULE
 FLEX I/O TERMINAL BASE
 1734TBSJ

19000
19001
19002
19003
19004
19005
19006
19007
19008
19009
19010
19011
19012
19013
19014
19015
19016
19017
19018
19019
19020
19021
19022
19023
19024
19025
19026
19027
19028
19029
19030
19031
19032
19033
19034
19035
19036
19037
19038
19039

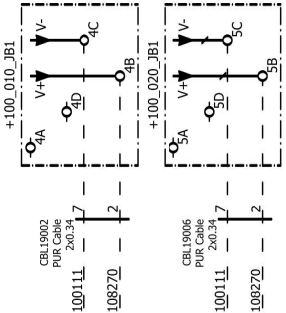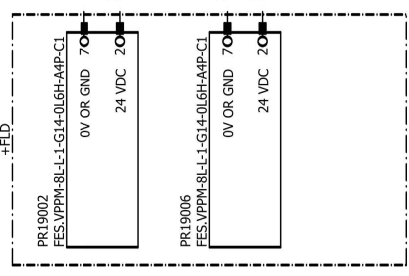

Pos. 100.010 Belt Tensioner

Pos. 100.020 Belt Tensioner

19040
19041
19042
19043
19044
19045
19046
19047
19048
19049
19050
19051
19052
19053
19054
19055
19056
19057
19058
19059
19060
19061
19062
19063
19064
19065
19066
19067
19068
19069
19070
19071
19072
19073
19074
19075
19076
19077
19078
19079

